


NOTE

* UNLESS OTHERWISE SHOWN, MANHOLES SHALL HAVE 0.1 FALL FROM UPSTREAM INVERT TO DOWNSTREAM INVERT. FOR PIPE SLOPES GREATER THAN 2.5% SLOPE, SEE PLAN AND PROFILE.

**PLAN VIEW
48" ID CHANNELLED BASE**
N.T.S.

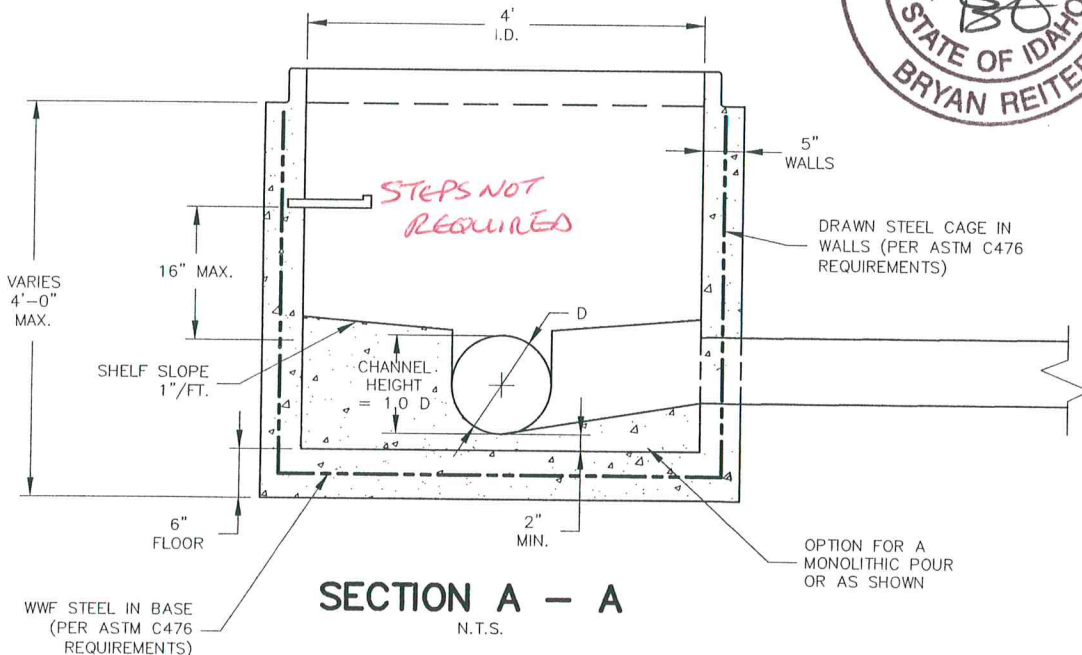

SECTION A - A
N.T.S.

2008 REVISIONS

IDAHO STANDARDS
FOR PUBLIC WORKS
CONSTRUCTION

**STANDARD MANHOLE
PRECAST BASE TYPE A**

STANDARD DRAWING
NO. **SD-501A**